



**SURAT MUNICIPAL CORPORATION
FIRE & EMERGENCY SERVICES
HEAD QUATERS, MUGLISARA,
SURAT - 395003**

Ph.: S.M.C. : 0261 - 2423750 TO 56, CONTROL : 2414195 -96, FAX : 2451935, 9724345553

Sub :- N.O.C./OPINION Fire & Emergency Services Dept. for High Rise Residential Building.

Reference :- A letter from T.D.O. Shri bearing No. T.D.O.4526, Dt.12/02/2021.

PROPOSED SITE :- REVISED RESIDENTIAL HIGH RISE BUILDING PLAN FOR T.P.S. NO. 37 (ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK NO. 190/2, MOJE. ALTHAN, TA. MAJURA, DIST. SURAT.

Submitted,

As per said plan the above building is a High Rise Residential Building. A,B (Basement-1 + Basement-2 + Ground Floor + 14th Floor) with Height of 45.00 Mtrs.

As per N.B.C. 2016 the aforesaid buildings are to be considered as High Rise Residential Building. Hence this dept. has No Objection if the applicant concerned makes necessary fire fighting arrangement in said building as per N.B.C. norms, Existing CGDCR norms, Gujarat Fire Prevention Life Safety Regulation 2017 and Submitted Drawing. Subject to compliance of following fire safety recommendations by the developer/owner during & after construction.

1. Parking shall not be permitted in courtyards and drive ways of fire appliances.
2. Courtyard shall be kept free from encumbrances & encroachments.
3. No structure of any type shall be permitted in courtyard of the building.
4. There shall not be any trees obstructing fire appliances reach in compulsory open spaces required as per CGDCR.
5. The gradient of the ramp shall not be steeper than 1:07.
6. The access provided to the basement shall be kept unobstructed.
7. Repairing/servicing of cars, use of naked light shall not be permitted in the car parking areas.
8. Dwelling, use of naked light / flame, repairing / maintenance of vehicles shall be strictly prohibited in the parking area.
9. The driveways shall be property marked and maintained unobstructed, proper illuminated signage shall be provided for escape route.
10. Car parking shall be permitted in the designated area only.
11. The fins with RCC, brick work, hallow blocks or any such construction materials shall not be permitted.
12. The driveways shall be properly marked and maintained unobstructed, proper illuminated signage shall be provided for escape route, car lifts, etc. at prominent location.
13. The layout of staircase shall be enclosed type throughout its height and shall be approached at each floor level.
14. Externally located staircases adequately ventilated to outside air.
15. Permanent vent at the top equal to 5 % of the cross sectional area of the staircase shall be provided.



16. Structural steel members connected to staircase shall be protected with fire retardant coatings.
17. No combustibles shall be kept or stored in staircase / passages.
18. The staircase should not be encroached by shoe-rack, decorative items, earthen pots etc.
19. Walls enclosing lift shaft shall have a fire resistance of not less than two hours.
20. Shaft shall have permanent vent of not less than 0.2 sq. meters in clear area immediately under the machine room.
21. Landing door and lift car door of the lifts shall be of steel shuttered with fire resistance of one hour. No collapsible shutter shall be permitted.
22. The Fire lift shall have a floor area of not less than 1.4 sq. meters it shall have loading capacity of not less than 545 kgs (8 persons lift) with automatic closing doors of minimum 0.8 m. width.
23. The electric supply of fire lift shall be on a separate service from electric supply mains in a building and the cables run in a route safe from fire i.e. within the lift shaft. Light & fans in the elevators having wooden paneling or sheet steel constriction shall be operated on 24 volt supply.
24. Fire lift should be provided with a ceiling hatch for use in case for emergency. So that when the car gets stuck up, it shall be easily openable.
25. In case of failure normal electric supply, it shall automatically changeover to alternate supply. For apartment houses, this changeover of supply could be done through manually operated changeover switch. Alternatively, the lift shall be so wired that in case of power failure, it comes down at the ground level and comes to stand-still with door open.
26. The operation of fire lift should be by a simple toggle or two button switch situated in glass-fronted box adjacent to the lift at the entrance level. When the switch is on, landing call point will become inoperative and the lift will be on car control only or on a priority control devices. When the switch is off, the lift will return to normal working. This lift can be used by the occupants in normal times.
27. The words 'fire lift' shall be conspicuously displayed in fluorescent paints on the lift landing doors at each floor level.
28. The speed of the fire lift shall be such that it can reach the top floor from ground level within one minute. Fire lift shall be constructed as per prevailing standard.
29. Corridor / lift lobby at each floor level shall be naturally ventilated as shown in plan for the upper floors.
30. The common corridor / lift lobby at each floor level shall be kept free from obstruction at all times.
31. Self-glowing / fluorescent exit signs in green colour shall be provided showing the means of escape at each floor of building. Portable lights / insta lights shall be provided at strategic location in the staircase and lift lobby.
32. The staircase and corridor lighting shall be on separate circuits and shall be independently connected so that they could be operated by one switch installation on the ground floor easily accessible to fire fighting staff at any time irrespective of the position of the individual control of the light points, if any.
33. Staircase and corridor lighting shall also be connected to alternate supply.
34. Double throw switches shall be installed to ensure that lighting in the staircase and the corridor do not get connected to two sources of supply simultaneously. A double throw switch shall be installed in the service room to terminate the stand-by-supply.
35. Emergency lights shall be provided in the staircase / corridors.
36. Electric cable shaft shall be exclusively used for electric cables and should not be open in staircase enclosure.
37. Electric shaft shall be sealed at each floor level with non-combustible material such as vermiculite concrete. No storage shall be permitted in electric cabin or shaft.

38. Inspection door for the shaft shall have two hours fire resistance.
39. Electric wiring / cable shall be of non-toxic, non-flammable, low smoke hazard having copper core fire resistance for the entire building with provision of ELCB/MCB.
40. Electric meter room shall be adequately ventilated, accessible & shall not be under staircase, basement, lift-lobby.
41. Electric wiring shall be having copper core having the fire resistance and low smoke hazard cables for the entire building with provision of ELCB/MCB
42. Low and medium voltage wiring running in shaft and in false ceiling should run in separate conduits.
43. Water mains, telephone lines, intercom lines, gas pipes or any other services should not be laid in the duct for electric cable; use of bus bar/solid rising mains instead of cables is preferred.
44. Separate circuits for fire fighting pumps, lifts, staircase and corridor lighting and blowers for pressurizing system shall be provided directly from the main switch gear panel and these circuits shall be laid in separate conduit pipes so that fuse in one circuit will not affect the others. Such circuits shall be protected at origin by an automatic circuit breaker with its no-volt coil removed.
45. Master switches controlling essential services shall be clearly labeled & provide in the lobby for emergency operation.
46. False ceiling if provided in the building shall be of non-combustible material. Similarly, the suspenders of the false ceiling shall be of non-combustible materials.
47. Materials For Interior Decoration / Furnishing :
The use of materials which are combustible in nature and may spread toxic fumes/gases should not be used for interior decoration/furnishing, etc.
48. (A) Basement shall be ventilated naturally/mechanically. If naturally ventilated vents with cross sectional area (Aggregate) not less than 2.5 percent of the floor area spread evenly around the perimeter of the basement shall be provided.
(B) The basement shall be used for designated purpose only as shown in the plan.
49. The staircase of the basement shall be of enclosed type and entry to basement areas shall be through two hours higher resistance self closing door provided in the enclosed wall of the staircase and through smoke check/cut off lobby.
50. Suitable signage's shall be provided in the basement showing exit direction way to exit etc.
51. Exhaust duct, mechanical ventilation duct should not pass through exit or entry.
52. The basement beyond building line shall be paved; suitably to bear the load of fire engines weighing up to 40 m. tones each with point load of 10 kgs. /sq. cms.
53. Fire drill / evacuation drill :
Fire drill and evacuation drill shall be conducted regularly in accordance with fire safety plan of building at least once in a three month in consultation with Mumbai fire brigade and log of the same shall be maintained.
54. Signage's :
Self-glowing/fluorescent exit signs in green color shall be provided showing the means of escape of the building.
55. Fire Escape Chute : **NOT APPLICABLE.**
56. **Refuge area : External balcony/deck in Bldg. A,B is considered as a Refuge Area.**
Therefore any alteration in future shall not be allowed .
57. The entry/exit shall be kept free for any obstruction.
58. Astro turf etc. shall not be permitted in the courtyard and in the drive way.
59. A certificate to the effect that the fire resistance protection has been provided as above shall be furnished from the Structural Engineer/Architect at the time of applying for occupation of the building.


60. All gaps between floor-slabs and to facade assembly shall be sealed at all levels by approved fire resistant Seal and material of 02 hrs fire rating.
61. Sprinkler system for glass facade providing full coverage to the glass.
62. Addressable Fire Alarm & Detection System as per NBC-2016 (Table-7).
63. Openable panels shall be provided on each floor and shall be spaced not more than 10 mt apart measured along the external wall from centre to centre of the access opening.
64. This NOC is issued from fire risk point of view only.
65. Trained man power shall be available for the fire fighting and lift rescue in the building premises round the clock.
66. Any deviation w.r.t. construction shall be verified by the concerned building sanctioning authority.
67. The certificate may not be treated in any case for regularisation for unauthorised construction if any.
68. Form 16 from FPCOR to be submitted at the time of Fire Inspection of building.
69. The opinion is given on the basis of submitting drawings /documents only.
70. Facade & Elevation Design & Drawing shall have to be approved by Registered Facade Consultant.
71. Any other instructions given by the fire department from time to time about fire safety of the Building premises to be followed norms.
72. Fire officer can check the arrangements of Fire safety at any time, this certificate will be withdrawn without any notice if any deficiency is found.
73. Occupants /Owner should apply for renewal of fire safety certificate 01 Month prior expiry of this certificate.
74. Trained officers / security guards :
The trained security / fire supervisor along with trained staff having basic knowledge of firefighting & fix firefighting installation shall be provided / posted in the building.
They will be responsible for the following;
 - (a) Maintenance of all the first aid firefighting equipment, fixed installations & other firefighting equipment / appliance in good working condition at all times.
 - (b) Imparting training to the occupants of the building in the use of firefighting equipment provided on the premises & keep them informed about fire & other emergency evacuation procedures.
 - (c) To liaise with the city fire brigade on regular & continual basis.
 - (d) The mock drill with the designated fire marshal for any operation of disaster management plan shall be out regularly after occupation as per National Building Code.
75. The fire department of SMC will not responsible for any loss of life and property due to Fire / Emergency incident.

T.D.O. Shri ,
For information & further process please.

(I/C Dy Chief Fire Officer)

FES/ OUTWARD/NOC 1841
DT.20 02 -2021




I/C CHIEF FIRE OFFICER
Surat Municipal Corporation

SHRADDHA

FIRE AND SAFETY SERVICES
ISO 9001 : 2015 Certified Company

TO,
I/C CHIEF FIRE OFFICER,
FIRE & EMERGENCY SERVICES,
SURAT MUNICIPAL CORPORATION,
MUGLISARA, SURAT.

SUBJECT: Approval of Fire Fighting Layout Plan

Respected Sir.

On the above cited subject, we want to install Fire Fighting System in our Residential building "REVISED RESIDENTIAL HIGH-RISE BUILDING PLAN FOR T.P.S. NO. 37 (ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK. NO. 190/2, MOJE. ALTHAN, TA. MAJURA, DIST. SURAT."

We enclosed drawing layout for Fire Fighting System approval.

PROJECT DETAIL:

Site	T.P.S. NO. 37 (ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK. NO. 190/2
Location	ALTHAN
Type Of Building	HIGH RISE RESI. BLDG
No. Of Floor & Height	BLDG. A,B = 2B+G+14 (45.00 MT)
No of Building	2

You are hereby requested kindly give us approval for installation of Fire Fighting System as per drawing layout.



[Signature]
20-2-2021

I/C. Chief Fire Officer,
Fire & Emergency Services,
Surat Municipal Corporation



Address : 119, Zenon, Nr Opera House, Opp Unique Hospital, Bamroli Road, Surat 395 002.

E-mail : shraddhafire25@gmail.com / info@shraddhafiresafetysurat.com


Contact No. : +91 82384 43617 +91 92743 14932

Website : www.shraddhafiresafetysurat.com

**"REVISED RESIDENTIAL HIGH-RISE BUILDING PLAN FOR T.P.S. NO. 37
(ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK. NO. 190/2, MOJE. ALTHAN,
TA. MAJURA, DIST. SURAT."**

BASIC DATA TAC PUBLICATION GDRC AND N.B.C. PART IV

Sr.No.	PARTICULARS	DESCRIPTIONS
1.	Supposition of Risk	Coverage of all natural and man-made fire threats.
2.	No. of Hydrant valves / Sprinklers	35 / 245
3.	Pump size with flow	90MTR@ 1620 LPM
4.	Fire Water Tank Required	75,000 liters
5.	Rating for Main Pump Hydrant / Sprinkler	40HP - 44.72KW
6.	Rating for Jockey Pump	10.8m ³ /hr or 3ltr/sec. Pump Head 90 mtr 12.5HP - 7.45KW
7.	Flow consideration for pressure loss to calculate at farther point	47.5 ltr/sec. 47.5/2=23.75 lps
8.	Salient Features	CE Marked Motor, With Energy Efficient Motor (SPDP optional), "F"- Class Insulation, IP 55, Option with 2 & 4 Pole Motors, Back Pull-out Design
9.	Applications	For Fire Fighting in commercial applications
10.	Assumed pipe diameter Hit & Trial method	100mm NB & 100mm NB
11.	Size of Suction Header	100mm Dia(Positive suction)
12.	Size of Discharge Header	100mm NB
13.	Type of valve in pump room at suction side	100mm Salves Valves/ Gate Valves
14.	Type of Valve in pump room at Discharge side	100mm Salves Valves/ Gate Valves
15.	Loop line valve outside pump room for main distribution line	100mm Salves Valves/ Gate Valves
16.	Actual Fire water storage tank capacity	75,000 liters
17.	Pump Room	Positive Suction (6L *5.5W*4 H pump room size in mtr.)
18.	Pressure at rest of area	Minimum 3.5Kg/cm ²
19.	Type of system	Automatic Operated Wet System
20.	Back up for Emergency	Diesel Pump
21.	Fire Alarm System	Automatic Information
22.	Building Height	45.00 MTR




[Signature]
20.2.2021
I/C. Chief Fire Officer,
Fire & Emergency Services,
Surat Municipal Corporation

**“REVISED RESIDENTIAL HIGH-RISE BUILDING PLAN FOR T.P.S. NO. 37
(ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK. NO. 190/2, MOJE. ALTHAN,
TA. MAJURA, DIST. SURAT.”**

The fire safety items given below are implanted in the Market as per
TACPublication and GDCR-2017 and N.B.C. Part IV.

Sr.	FIRE HYDRANT SYSTEM	BRAND	QUANTITY
1	MONO BLOCK PUMP 40 HP	Lubi/ Kirloskar/ Pew	01
2	JOCKEY PUMP 12.5 HP	Lubi/ Kirloskar/ Pew	01
3	PUMP PANEL	L & T	01
4	Terrace Pump	Lubi/ Kirloskar	02
5	Diesel Pump 50 HP	Lubi/ Kirloskar/	01
6	G.I.PPIPE "C" CLASS 100 mm ISI (IS : 1239 Part - II/3589)	Asian/Jindal	1850
8	G.I.PPIPE "C" CLASS 80 mm ISI (IS : 1239 Part - II/3589)	Asian/Jindal	250
9	Butterfly Valve C.I. ISI (IS : 13095)	Kranti	08
10	NRV Valve C.I. 150 mm ISI (IS : 13095)	Kranti	---
11	NRV Valve C.I. 100 mm ISI (IS : 13095)	Kranti	07
12	SLUICE VALVE C.I. 150 mm ISI	Kranti	01
13	SLUICE VALVE C.I. 100 mm ISI	Kranti	01
14	Y Type Strainer C.I. 150 mm ISI	Kranti	01
15	GM air release valve SS ISI	Kranti	02
16	Inlet Four way C.I. 150 mm ISI (IS : 904)	Essel	01
17	Hydrant Valve 63 mm SS ISI (IS : 5290)	Swati	35
18	Hose Reel 19mm Length 30mtr with Rubber hose IS : 444 Type 2	Atasi	34
19	Hose Box with Hose Pipe Length 15mtr (ISI 636 Type (A))	Atasi	35
20	ABC Type Fire Extinguisher Capacity - 6 Kg ISI (IS : 15683)	Kenex/Mahavir	34
21	CO ₂ Type Fire Extinguisher Capacity - 4.5 Kg ISI (Is : 2878)	Kenex/Mahavir	34
22	PRESSURE GAUGE	L & T	01
23	PRESSURE SWITCH	L & T	02



20-2-2021
I/C. Chief Fire Officer,
Fire & Emergency Services,
Surat Municipal Corporation

**“REVISED RESIDENTIAL HIGH-RISE BUILDING PLAN FOR T.P.S. NO. 37
(ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK. NO. 190/2, MOJE. ALTHAN,
TA. MAJURA, DIST. SURAT.”**

The fire safety items given below are implanted in the Market as per TACPublication and GDCR-2017 and N.B.C. Part IV.

Sr.	FIRE SPRINKLER SYSTEM	BRAND	QUANTITY
1	MONO BLOCK PUMP	Lubi/ Kirloskar	---
2	JOCKEY PUMP	Lubi/ Kirloskar	--
3	PUMP PANEL	L & T	--
4	G.I.PPIPE "C" CLASS ISI (IS : 1239)	Asian/Jindal/TATA	450
5	Butterfly Valve C.I. ISI (IS : 13095)	Kranti	06
6	NRV Valve C.I. 150 mm ISI (IS : 13095)	Kranti	---
7	NRV Valve C.I. 100 mm ISI (IS : 13095)	Kranti	02
8	SLUICE VALVE C.I. 150 mm ISI	Kranti	01
9	SLUICE VALVE C.I. 100 mm ISI	Kranti	01
10	Y Type Strainer C.I. 150 mm ISI	Kranti	01
11	Rose Pendant Type Sprinkler	Tyco	245
12	PRESSURE GAUGE	L & T	----
13	PRESSURE SWITCH	L & T	01



[Signature]
20.2.2021
I/C. Chief Fire Officer,
Fire & Emergency Services,
Surat Municipal Corporation


**“REVISED RESIDENTIAL HIGH-RISE BUILDING PLAN FOR T.P.S. NO. 37
(ALTHAN-SOUTH), O.P. NO. 36, F.P. NO. 52, BLOCK. NO. 190/2, MOJE. ALTHAN,
TA. MAJURA, DIST. SURAT.”**

The fire safety items given below are implanted in the Market as per
TACPublication and GDCR-2017 and N.B.C. Part IV.

Sr.	FIRE ALARM SYSTEM	BRAND	QUANTITY
1	Addressable Fire Alarm Panel with Automation System (ONLY 1 ST BASEMENT FLOOR)	Agni suraksha/System sensor	01
2	Addressable M.C.P with Automation System ABS	Agni suraksha/System sensor	34
3	Addressable Hooter with Automation System ABS	Agni suraksha/System sensor	34
4	Fire Door	Agni suraksha/System sensor	-----




I/C. Chief Fire Officer,
Fire & Emergency Services,
Surat Municipal Corporation

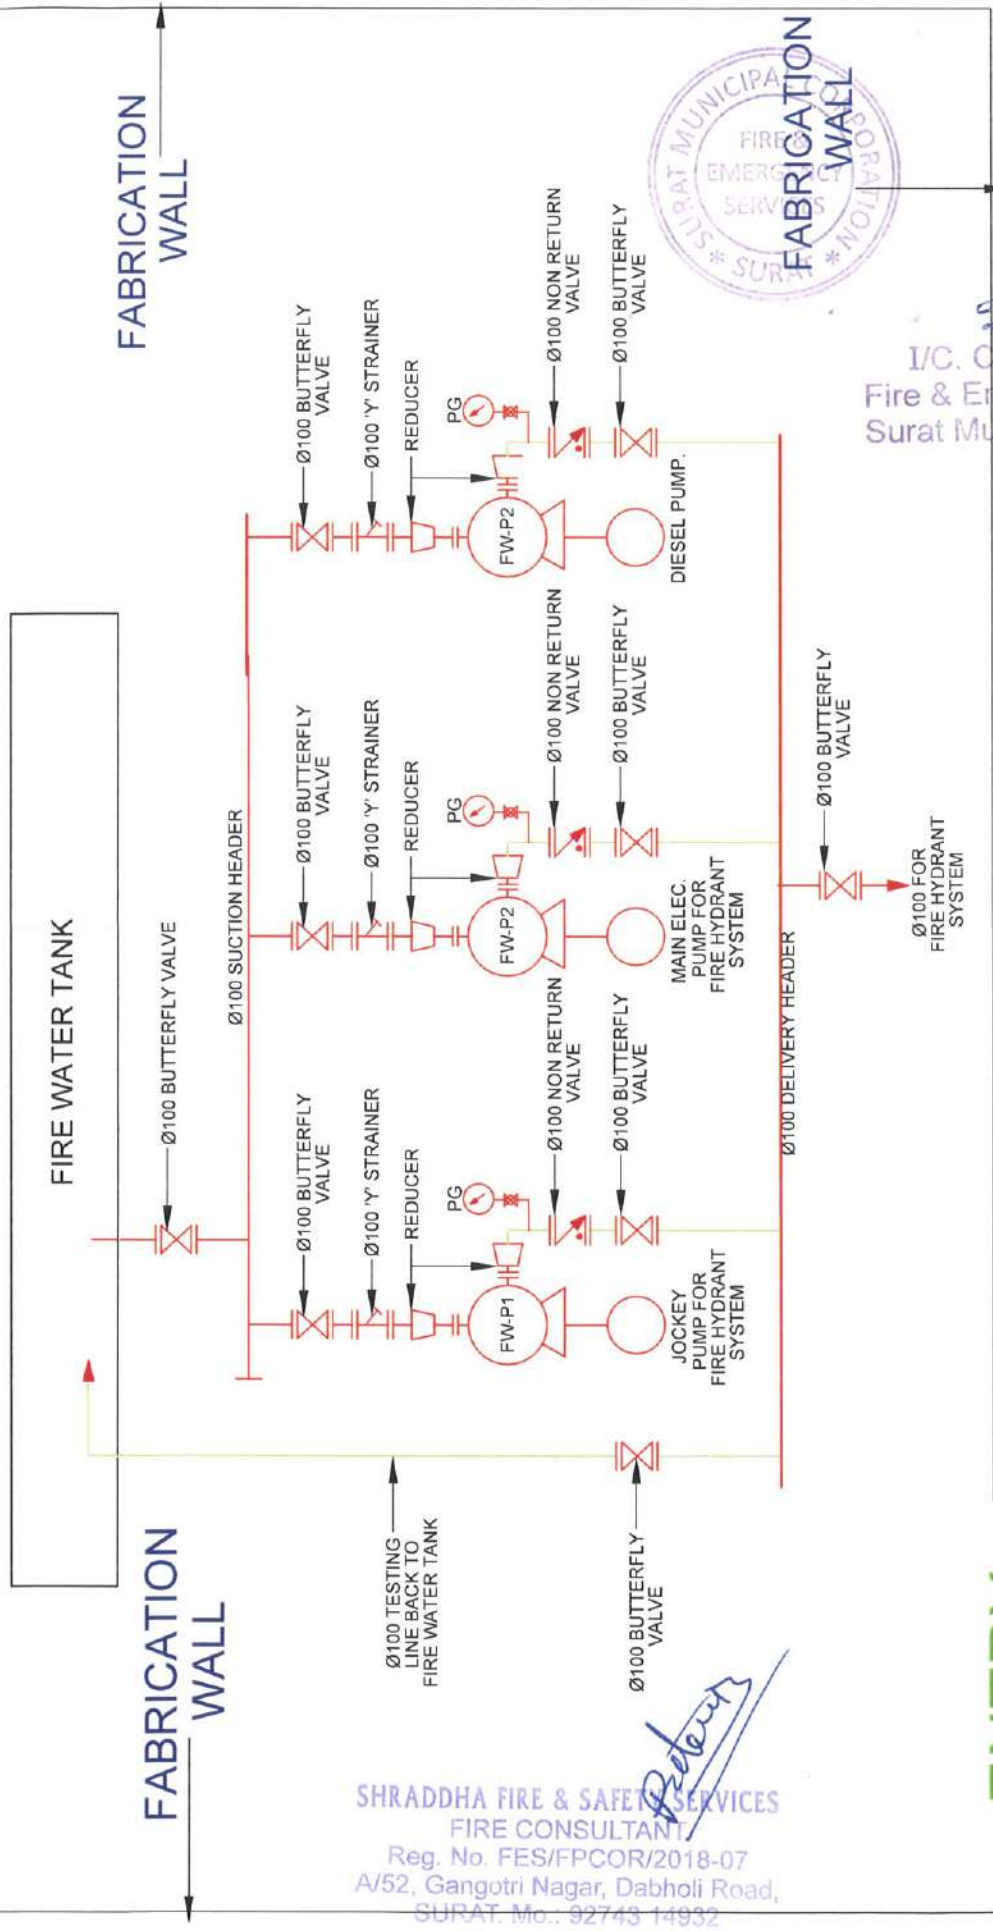

I/C. Chief Fire Officer,
Fire & Emergency Services,
Surat Municipal Corporation

P&ID OF FIRE PUMP ROOM

SHRADDHA FIRE & SAFETY SERVICES
FIRE CONSULTANT
Reg. No. FES/FPCOR/2018-07
A/52, Gangotri Nagar, Dabholi Road,
SURAT. Mo.: 92743 14932

કલેક્ટર અને જિલ્લા મેજિસ્ટ્રેટની કચેરી, સુરત

જિલ્લા સેવા સદન-૨, બી-બ્લોક, પાંચમો માળ, અઠવાલાઇન્સ, સુરત - ૩૯૫૦૦૧ (ગુજરાત)

ફોન નંબર : ૦૨૬૧-૨૬૫૫૧૫૧

ઇ-મેઇલ : collector-sur@gujarat.gov.in

ગુજરાત જમીન મહેસૂલ અધિનિયમ-૧૯૭૯ ની કલમ-૬૫ હેઠળ [બિનખેતી - બહુહેતુક ઉપયોગ]

હુકમ નં. 1332/22/20/002/2020

તા. 28/12/2020

વંચાણે લીધા :-

- (૧) અરજદારશ્રી ચંદ્રહાસ ગબલભાઈ પટેલ રહે. બી-૫૧, આશીર્વાદ રેસીડેન્સી, ચાઈના ગેટ-૨ પાસે, ન્યુ સીટી લાઈટ રોડ, અલથાણ, સુરત-૩૯૫૦૧૭ ની તા.૦૯/૧૦/૨૦૨૦ ની ઓનલાઇન અરજી (નં.62220202095890) તથા સોગંદનામું
- (૨) મુંબઈ જમીન મહેસૂલ કાયદો ૧૯૭૯ ની કલમ - ૪૮, ૬૫, ૬૬ તથા ૬૭
- (૩) ગુજરાત જમીન મહેસૂલ નિયમો, ૧૯૭૨ ના નિયમ ૮૧, ૧૦૦, ૧૦૧, ૧૦૨
- (૪) સરકારશ્રીના મહેસૂલ વિભાગનાં ઠરાવ નં. બખપ/૧૦૦૬/૪૨૫/ક તા.૦૧/૦૭/૨૦૦૮
- (૫) સરકારશ્રીના મહેસૂલ વિભાગનાં પરિપત્ર ક્રમાંક: બખપ/૧૦૨૦૧૮/૩૨૭/ક તા.૦૮/૦૫/૨૦૧૮
- (૬) સરકારશ્રીના મહેસૂલ વિભાગના ઠરાવ ક્રમાંક: એસ/ટીપી/૧૨૨૦૯/૭૬૯/૧૧/હ.૧ તા.૩૧/૦૩/૨૦૧૧
- (૭) સરકારશ્રીના મહેસૂલ વિભાગનાં ઠરાવ ક્રમાંક: બખપ/૧૦૨૦૧૮/૪૨૫/ક તા.૦૯/૦૧/૨૦૧૯
- (૮) સરકારશ્રીના મહેસૂલ વિભાગનાં પરિપત્ર ક્રમાંક: બખપ/૧૦૨૦૧૮/૪૨૫/ક તા.૧૨/૦૨/૨૦૧૯
- (૯) નાયબ કલેક્ટર શ્રી (સ્ટેમ્પ ડ્યુટી) નો તા.13/10/2020 નો અભિપ્રાય મામલતદાર અને કૃષિપંચ શ્રી (ALT) નો તા.23/10/2020 નો અભિપ્રાય
- (૧૦) ITCMS પોર્ટલ પરની કેસ વિગત

હુકમ :-

વંચાણે લીધેલ કમ (૧) ની અરજી તથા સોગંદનામા થી અરજદારશ્રી ચંદ્રહાસ ગબલભાઈ પટેલ એ મોજે અલથાણ તા. મજુરા જિ. સુરત ના સરવે/બ્લોક નં. 190/૨ ના ક્ષેત્રફળ 4,350.00 ચો.મી. પૈકી ક્ષેત્રફળ 3,095.00 ચો.મી ની જમીન અંગે ગુજરાત જમીન મહેસૂલ અધિનિયમ-૧૯૭૯ ની કલમ-૬૫ હેઠળ બિનખેતીના હેતુ માટે પરવાનગી આપવા વિનંતી કરેલ છે.

૨. સવાલવાળી જમીનના ગામ નમૂના નં. ૭/૧૨ માં કબજેદારોની વિગત નીચે મુજબ છે.

સરવે/બ્લોક નંબર ટી.પી. નંબર એફ.પી. નંબર	માંગણીનું ક્ષેત્રફળ (ચો.મી.)	કબજેદારોના નામ (ખાતા નં. 1534)	જમીનનો સત્તાપ્રકાર (૭/૧૨ મુજબ)
સરવે/બ્લોક નં. : 190/૨ જુનો સરવે/બ્લોક નં. : --- ટી.પી. નં. : ૩૭ અલથાણ સાઉથ એફ.પી. નં. : ૫૨	3,095.00	ચંદ્રહાસ ગબલભાઈ	ગણોત ધારા કલમ ૪૩ પ્રસપ્ત

૩. વસુલ કરવામાં આવેલ કરવેરાની વિગત નીચે મુજબ છે.

બેંકમાં ચલન ભર્યા તા.22/12/2020 નં.57000013551003521122055291

કરની વિગત	સદર	માંગણીનું ક્ષેત્રફળ (ચો.મી.)	દર રૂ. પ્રતિ ચો.મી.	કુલ રકમ રૂ.
રૂપાંતર કર	569-0035-00-800-01	3,095.00	40.00	1,23,800.00
વિશેષ ધારો	570-0035-00-101-01	3,095.00	0.60	1,857.00
લોકલ ફંડ	574-0029-00-103-01	3,095.00	0.30	929.00
શિક્ષણ ઉપકર	575-0045-00-108-01	3,095.00	0.15	464.00
માપણી ફી	577-0029-00-106-01	3,095.00	---	1,200.00
કુલ રૂ.				1,28,250.00

૪. ઉપર્યુક્ત તમામ હકીકતો ધ્યાને લઈ મોજે અલથાણ તા. મજુરા જિ. સુરત ના સરવે/પ્લોટ નં. 190/૨ ના ક્ષેત્રફળ 4,350.00 ચો.મી. પૈકી ક્ષેત્રફળ 3,095.00 ચો.મી ની જમીનને નીચે જણાવેલ શરતોને આધિન ગુજરાત જમીન મહેસૂલ અધિનિયમ-૧૮૭૯ ની કલમ-૬૫ હેઠળ બિનખેતી હેતુ (બહુહેતુક ઉપયોગ) માટે પરવાનગી આપવા આથી હુકમ કરવામાં આવે છે.

શરતો :-

- (૧) આ હુકમ મળ્યેથી બે માસમાં "એમ" નમૂનામાં સનદ પ્રાપ્ત થશે.
- (૨) જિલ્લા ઇન્સ્પેક્ટરશ્રી, જમીન રેકર્ડની કચેરીમાં માપણી ફી જમા કરાવેલ છે. જેથી માપણી કરી / કરાવી આ હુકમ આધારે તેમજ મંજૂર થયેલ પ્લાન મુજબ દુરસ્તી પત્રક તૈયાર કરવાનું / કરાવવાનું રહેશે અને દુરસ્તી પત્રકનો મહેસૂલી દફતરે અમલ થયા બાદ જ પ્રશ્નવાળી બિનખેતીની જમીન / પ્લોટનું રજી. દસ્તાવેજથી થયેલ વેચાણ વ્યવહારના અમલ માટે નોંધ પાડવાની રહેશે.
- (૩) અરજદારે પ્રતિ વર્ષે ખેતી સિવાયનો ધારો (વિશેષધારો) દર પ્રતિ ચો.મી. ના રૂ. 0.60 પ્રમાણે રૂ. 1,857.00 તેમજ નિયમ પ્રમાણે લોકલ ફંડ તથા શિક્ષણ સેસ ભરવો પડશે જે અંગેનો દર વખતોવખત ફેરફારને પાત્ર રહેશે.
- (૪) સુરત મહાનગરપાલિકા એ મંજૂર કરેલા પ્લાન મુજબ બાંધકામ કરવાનું રહેશે અને હુકમ થયા તારીખથી ત્રણ વર્ષમાં બાંધકામ પૂર્ણ કરવાનું રહેશે.
- (૫) સરકારશ્રીના મહેસૂલ વિભાગના ઠરાવ નં. બખપ/૧૦૯૩/૧૦૫૨/ક તા. ૧૩/૦૯/૧૯૯૩ માં ઠરાવ્યા મુજબ સહીયારા / કોમન પ્લોટ અને રસ્તાની જમીન સોસાયટીની માલિકીની અથવા સર્વે પ્લોટ હોલ્ડરની સહીયારી માલિકીની ગણાશે તે ઉપર મુજબ માલિકનો કોઈ હકક રહેશે નહિ.
- (૬) સરકારશ્રીના મહેસૂલ વિભાગના તા. ૦૭/૦૮/૧૯૯૧ ના પરિપત્ર નં. બખપ-૧૦૯૧/૧૭૫૬/ક ની જોગવાઈ મુજબ બિન અધિકૃત બાંધકામ બાબતે બાંધકામ નિયંત્રણ કરતી સંબંધિત મહાનગરપાલિકા / શહેરી વિસ્તાર સત્તા મંડળએ ધોરણસરનાં પ્રગણાં લેવાના રહેશે.
- (૭) સદર જમીનમાંથી પેટ્રોલીયમ / પાણીની કે અન્ય કોઈપણ પ્રકારની પાઇપલાઇન પસાર થતી હશે તો તે સંદર્ભે વિકાસ પરવાનગી આપનાર ઓથોરિટીએ સંબંધિતોનું ના-વાંધા પ્રમાણપત્ર મેળવી વિકાસ પરવાનગી આપવાની રહેશે.
- (૮) સરકારશ્રીના મહેસૂલ વિભાગના તા.૧૨/૦૨/૨૦૧૯ ના પરિપત્ર નં.બખપ/૧૦૨૦૧૮/૪૨૫/ક મુજબની નીચેની શરતોનું પાલન કરવાનું રહેશે.
 ૧. જો અગાઉ ચોક્કસ હેતુ માટે પ્રિમિયમ ભરપાઇ થયેલ હોય અને અન્ય હેતુ માટે વિકાસ પરવાનગી માંગેલ હોય/ નકશા મંજૂર કરવાના થતા હોય તો વિકાસ પરવાનગી આપતાં પહેલાં પ્રિમિયમ તફાવત ભરાયાની સંબંધિત સત્તામંડળે ખાતરી કરવાની રહેશે અને ત્યારબાદ જ વિકાસ પરવાનગી આપવાની રહેશે.
 ૨. જીડીસીઆર મુજબ જે તે હેતુ/ ઉપયોગ માટે પરવાનગી મળવાપાત્ર નહિં હોય તો તે ઉપયોગ કરી શકાશે નહિં.
 ૩. ખેતી ઝોનમાં જીડીસીઆર મુજબ જેટલું બાંધકામ મળવાપાત્ર હશે તેટલા જ ક્ષેત્રફળ માટે વિકાસ પરવાનગી આપવાની રહેશે.
 ૪. બિનખેતી પરવાનગી મળ્યા બાદ જો ખાસ મંજૂરી વિના ધાર્મિક ઉપયોગ માટે બાંધકામ કરેલ હશે તો તે શરતભંગ ગણાશે અને તે બાંધકામ દૂર કરવાપાત્ર થશે.
- (૯) સરકારશ્રીનાં મહેસૂલ વિભાગનાં તા. ૦૧/૦૭/૨૦૦૮ ના ઠરાવ નં. બખપ/૧૦૦૬/૪૨૫/ક માં જણાવેલ નીચે મુજબની શરતોનું પાલન કરવાનું રહેશે.
 ૧. જિલ્લા ઇન્સ્પેક્ટરશ્રી, જમીન રેકર્ડ દ્વારા ઇસ્યુ કરાયેલ માપણી શીટ કે જેના ઉપર મૂળ ટિપ્પણની હદ પણ દર્શાવેલ હોવી જોઈએ. રજૂ કરાયેલ પ્લાન તથા લે-આઉટ પ્લાન સક્ષમ કક્ષાએ મંજૂર કરાયેલ હોવી જોઈએ.
 ૨. બાંધકામ શરૂ કરતા પહેલાં બાંધકામનાં નકશા સક્ષમ અધિકારી પાસે મંજૂર કરાવવાના રહેશે. પરંતુ અરજદાર બિનખેતી પરવાનગી મેળવ્યા વગર આવા બાંધકામની રજા ચિઠ્ઠી મેળવી શકશે નહિ.
 ૩. શહેરી વિસ્તાર જ્યાં ટાઉન પ્લાનિંગ સ્કીમ મંજૂર થઇ ગઇ છે ત્યાં જી.ડી.સી.આર. અને ઝોનિંગના નિયમો અનુસાર બાંધકામ કરવાનું રહેશે.
 ૪. મંજૂર થયેલ નકશા મુજબ આરોગ્ય અને સ્વાસ્થ્યની દ્રષ્ટિએ ગંદા પાણીનાં નિકાલની જોગવાઈ કરવાની રહેશે.
 ૫. અરજદારે રિબન ડેવલપમેન્ટ રુલ્સ નીચે જે તે રસ્તાનો પ્રકાર ધ્યાને લઈ રસ્તાના મધ્યબિંદુથી બાંધકામ વચ્ચે અંતર જાળવવાનું રહેશે અન્યથા અરજદારની જવાબદારી થશે.
 ૬. ફ્લોર, મિલ, સિનેમા/ ટુરિંગ સિનેમા/ થિયેટર માટે બિનખેતી પરવાનગીના કામે જિલ્લા મેજિસ્ટ્રેટની જરૂરી મંજૂરી મેળવી આગળની કાર્યવાહી કરવાની રહેશે.
 ૭. પેટ્રોલ, ડીઝલ, કેરોસીન, સી.એન.જી., એલ.પી.જી. પંપ નાંખવા માટે બિનખેતી પરવાનગીના કામે બાંધકામ શરૂ કરતાં પહેલાં જિલ્લા મેજિસ્ટ્રેટની જરૂરી મંજૂરી મેળવી આગળની કાર્યવાહી કરવાની રહેશે.
 ૮. ઇન્ડિયન એક્સપ્લોઝિવ એક્ટ અન્વયે મેગેનિઝ, ફાયર વર્કસ, દારૂખાના માટે બિનખેતીની કાર્યવાહી કરતા પહેલાં જિલ્લા મેજિસ્ટ્રેટની જરૂરી મંજૂરી મેળવી આગળની કાર્યવાહી કરવાની રહેશે.

૯. સવાલવાળી જમીન જો રેલવે હદની નજીક હોય તો રેલવેની હદથી નિયમ મુજબ જગ્યા છોડી બાંધકામ કરવાનું રહેશે.
૧૦. સવાલવાળી જમીન ઉપરથી અથવા બાજુમાંથી વીજળી ગ્રિડના તાર/ હાઇટેન્શન પાવર અગર થાંભલા આવેલ હોય ત્યારે તે અન્વયે લાગુ પડતા નિયમોનું પાલન કરવા અને તે મુજબ બાંધકામ કરવાનું રહેશે.
૧૧. બિનખેતી માંગવામાં આવી હોય તેવી જમીન જો એરોડ્રામ આસપાસ નિયમ મુજબની ત્રિજ્યામાં આવતી હોય ત્યારે બાંધકામની ઉંચાઇ તથા એરોડ્રામની દ્રષ્ટિએ જરૂરી એવું ના-વાંધા પ્રમાણપત્ર સિવિલ એવિએશન ખાતા પાસેથી મેળવવાનું રહેશે અને સિવિલ એવિએશન ખાતાના નિયમોનું પાલન કરવાનું રહેશે.
૧૨. ઓ.એન.જી.સી. ના કુવાની નજીકમાં આવેલ જમીનના કિસ્સામાં અરજદારે સંબંધિત નિયમોનું પાલન કરવાનું રહેશે.
૧૩. નર્મદા કેનાલ/ અન્ય સિંચાઇ કેનાલની નજીકમાં આવેલ જમીનની બાબતમાં અરજદારે સૂચિત બાંધકામ માટે જાળવવાના થતાં અંતર અંગેના નિયમોનું પાલન કરવાનું રહેશે.
૧૪. અરજદારે/ જ્યાં જરૂરી હોય ત્યાં કેન્દ્ર સરકાર કે રાજ્ય સરકારના કાયદા નીચે રક્ષિત સ્મારક (Protected Monuments) તરીકે જાહેર કરેલ પ્રાચીન સ્મારકથી નિયમ મુજબનું અંતર જાળવવાની પ્રવર્તમાન જોગવાઈઓનું પાલન કરવાનું રહેશે.
- (૧૦) જો આ જમીન પર કોઇ બેંક/ મંડળીનો બોજો બાકી હોય તો, તે ભરપાઇ કર્યા સિવાય આ મિલકત કોઇપણ પ્રકારે વેચાણ, ભેટ, વસિયત, બાનાખત, ગિરો કરી શકાશે નહિ અને કોઇપણ અન્યને પ્રત્યક્ષ કે પરોક્ષ રીતે માલિકી કે કબજો ભોગવવો તબદીલ કરી શકાશે નહિ.
- (૧૧) પ્રશ્નવાળી જમીનમાં નગરપાલિકા/ મહાનગરપાલિકા/ શહેરી વિકાસ સત્તા મંડળ દ્વારા જે શરતોએ પરવાનગી આપવામાં આવશે તે શરતોનું પાલન તથા બાંધકામ કરવાનું રહેશે.
- (૧૨) આ જમીનમાં વરસાદી પાણીના ભુગર્ભ વહન/ સંચય માટે દર મકાન/ બહુમાળી મકાન દીઠ એકના દરે આ જમીનમાં ઉપર પરકોલેટીંગ બોરવેલની વ્યવસ્થા અચૂક કરવાની રહેશે તથા વરસાદી પાણીના નિકાલની વ્યવસ્થા કરીને બાંધકામ કરવાનું રહેશે.
- (૧૩) પ્રશ્નવાળી જમીનમાં સ્થળે થયેલ બાંધકામ સ્થાનિક સ્વરાજની સંસ્થાના નિયમોનુસાર નહિ હોય તો સ્થાનિક સ્વરાજની સંસ્થા નિયમોનુસાર કાર્યવાહી કરી શકશે. તેમાં આ હુકમથી બાધ આવશે નહિ.
- અરજદારે ઉપરોક્ત શરતોનું પાલન કરવાનું રહેશે. જો તેમાં નિષ્ફળ જશે તો શરતભંગ ગણી સક્ષમ અધિકારી કાયદેસરની કાર્યવાહી કરશે.
- (૧૪) ઉપરની કોઇપણ શરતનો ભંગ થયેથી જમીન મહેસૂલ કાયદાની કલમ-૬૭ મુજબ શિક્ષાત્મક પગલા લેવામાં આવશે તેમજ બીજી કોઇપણ શિક્ષાને પાત્ર હશે તો તેને બાધ આપ્યા સિવાય કે જે ફરમાવવાનું યોગ્ય લાગે તે પ્રમાણે દંડ અથવા આકાર લઇ સદરહુ જમીનનો કબજો કબજેદાર પાસે ચાલુ રહેવા દઇ શકાશે.
- (૧૫) ઉપરોક્ત શરતોમાં ગમે તે મજકૂર હોય તેમ છતાં, કલેક્ટરશ્રી સદરહુ હુકમ વિરુદ્ધ બાંધેલા અથવા વધારાના કોઇપણ મકાન અથવા ઇમલાને કલેક્ટરશ્રીએ, આ અર્થે જે મુદત ઠરાવી હોય તે મુદત દરમિયાન તેવી રીતે ખસેડવામાં ન આવે કે સૂચવ્યા મુજબ ફેરફાર ન કરવામાં આવે તો તેમ કરવામાં જે ખર્ચ થાય તે કબજેદાર પાસેથી જમીન મહેસૂલની બાકી તરીકે વસુલ કરવાને મુખત્યાર છે.

વધુમાં ઉપર્યુક્ત શરતોને આધીન અરજદાર દ્વારા રજુ થયેલ સોગંદનામાની વિગતોમાં તેઓ દ્વારા જાહેર કરેલી હકીકતોને આધારે સવાલવાળી જમીનના બિનખેતી ઉપયોગ માટે પરવાનગી આપવામાં આવે છે.

માન. કલેક્ટરશ્રીનાં આદેશાનુસાર
રવાના કરવા અધિકૃત

નાયબ કલેક્ટર (જ.સુ.)
સુરત.



સહી/-XXX
(ડૉ. ધવલ પટેલ)
કલેક્ટર, સુરત

આર.પી.એ.ડી.

પ્રતિ,

ચંદ્રહાસ ગબલભાઈ પટેલ

બી-૫૧, આશીર્વાદ રેસીડેન્સી

ચાઈના ગેટ-૨ પાસે, ન્યુ સીટી લાઈટ રોડ

અલથાણ

સુરત-૩૯૫૦૧૭

નકલ રવાના:-

૧. મુખ્ય અધિકારીશ્રી, સુરત મહાનગરપાલિકા

૨. મામલતદારશ્રી તા. મજુરા જિ. સુરત (હુકમનો અમલ ગામ દફતરે રેકર્ડ ઓફ રાઈટ્સ મુજબ કરાવવા સારું.)
૩. જિલ્લા ઇન્સ્પેક્ટરશ્રી જમીન રેકર્ડ જિ. સુરત
૪. તલાટીશ્રી અલથાણ તા. મજુરા જિ. સુરત તરફ.
૫. હજુર રેકર્ડકિપરશ્રી,, કલેક્ટર કચેરી, સુરત.

* આ હુકમની ઇ-ધરા કેન્દ્ર, મજુરા માં નોંધ નંબર ૩૯૪૯ થી મોજે. અલથાણ તા.- મજુરા જિ.- સુરત માં નોંધ થયેલ છે.

