



Vadodara Fire & Emergency Services
Vadodara Municipal Corporation.

1st Floor, City Command Control Center
Badamadi Baug, Vadodara - 390209
Phone 0265 - 2413635, 2413754, 2420881, 2413753
E-Mail - cfo@vmc.gov.in



Fire Safety Opinion



Reg No: - REG230100165

Date: - 26-07-2023

To,

GOPINATH ENTERPRISE AND OTHERS

BHAYLI

Taluka : VADODARA

Dist : Vadodara, Pincode - 391410

Subject : Fire Safety Opinion for the application made by concern person to Vadodara Fire and Emergency Services department for Building to be constructed at site details given below.

Reference : File submitted by you with Inward No.: IN230100302 Date.: 25-07-2023

Site Details: Moje : BHAYLI, BHAYLI, Taluka - VADODARA, Pincode - 391410, Gujarat, Plot No. 66 RS No. -, TP No.-04, FP No.-66

Type of Occupancy : Mixed Occupancy

Building Usage : Commercial+Residency

This is to inform the Applicant about the application made by him/her on date 25-07-2023 at the concern office with Application Letter and Plan/Drawing for issuing fire safety opinion for the place of Construction mentioned in subject. Considering your application for High-rise / Commercial / Residential Building necessary firefighting system installation and fire safety recommendation for public safety should be followed by Builder/Owner/Occupant all the time. Gujarat Fire Prevention and Life Safety Measures Act, 2013 Rules 2014/2021 and Regulations 2016/2018/2019 along with CGDCR Norms as applicable and NBC guidelines for fire safety should be strictly followed as per the nature of construction.

Building Plan/Drawing submitted by the applicant (Preferably from Registered Organization or Architect) should have all Firefighting arrangements as recommended in Gujarat Fire Prevention and Life Safety Measures Act, 2013, Rules 2014/2021, Regulations 2016/2018/2019, Chapter 04 of National Building Code 2016 and Comprehensive General Development Control Regulations 2017 at all-time as applicable.

Note: For any Building that falls under category where public safety comes under threat as per norms and was constructed before 2017 in person inspection will be done by concern Officer and changes if required will be recommended as per Gujarat Fire Prevention and Life Safety Measures Act, 2013, Rules 2014/2021, Regulations 2016/2018/2019, Chapter 04 of National Building Code 2016 and CGDCR, such changes must be done as suggested without any delay. (Important for TDO Department to take note of)

Details of the Plan/Drawing submitted by the applicant are found as per rules and regulations at time of application.

If in case any changes, addition or subtraction done by the Builder/Owner/Occupant in presented Plan/Drawing after getting necessary approval, the issued opinion certificate will be considered as terminated.

Site Details as per Plan/Drawing :


Type & Occupancy: Mixed Occupancy, Commercial+Residency
Height of Building: 32.95, 32.95
Area of Construction: 2409
Number of Towers: 2
Number of Basement/Floor: B+G+10, B+G+10
Building Name: GOPINATH ENTERPRISE AND OTHERS

Name and Number will be mentioned as per TDO Letter (No : 775/23-24, Date : 25-07-2023)only, in case of any changes in name and number or Dispute, Department of Vadodara Fire & Emergency Services will not take any

Once the construction of Building is done, inspection will be done by the concern officer if construction is found as per the proposed plan presented and satisfactory only then Fire Safety Certificate will be issued.

Note : For The Issued NOC Construction Should be done only till 44 meters of Heights as VFES Vadodara holds ALP 44 meters, Any height above 44 meters cannot be served in case of Emergency. Construction resume notice will be issued once Vehicle procurement is done.

Note :



Parth Brahmhatt
I/c. Chief Fire Officer
Vadodara Municipal Corporation
Vadodara

Place : Vadodara

(R.S.No.=Revenue Survey Number, CS No.=City Survey Number, FP=Final Plot, TP=Town Planning Scheme)

Copy to: Town Development Officer, Vadodara Municipal Corporation. Process initiated as per the law at our end.

General Requirement for Buildings:

- In reference to Chapter 4 of National Building Code of India all rules to be followed for Fire and Safety.
- Every tower should have 6 inch (150 MM) Internal Diameter (Above 18 Mtr.) GI pipe with Wet Riser system properly painted in red also Pipes which are underground should be covered and coated.
- On every floor of tower there should be proper Hose Box with Hose pipe of 63mm Diameter 1 Branch pipe with Valve on riser line. This condition should be applicable to all towers in case of multiple towers.
- Fire alarm should be placed on each and every floor, which should be audible to entire tower in case of emergency.
- 6KG Capacity ABC Stored pressure Fire Extinguisher & CO2 fire extinguisher of 4.5 KG Capacity 1 on every floor with ISI approved "Certificate" with Tower name.
- Courtyard/Margin should be as per standard and motorable road should be obstacle free for Hydraulic Elevated Platform to work in case of fire. (As per Drawing)
- Staircase should be constructed in such a way that Travel Distance should not exceed 22.5 Meters between two Staircase.
- Exits staircase and Fire Tower should have a Class-1 fire rating and material used for construction should have 4-hours fire resistance capacity
- One Skip Floor mandatory above 35 meters of construction which will be used as refuse area/Duplicate Pump room with system booster pump along with this 20,000 liters water tank.
- Passage road should be of 50 tons load bearing capacity.
- In case of multiple wings there should be joint service floor.
- Building used above 44 meters should not be done/ allowed till new Hydraulic platform is obtained
- For hollow parking sprinkler system is must with Yard Hydrant.
- Emergency Close Valve to be placed at Height of 4 Feet on Fire Hydrant Raiser line in each tower.

- All Fire Fighting Instruments irrespective of size must have Buildings name engraved or painted on it.
- All side of the Construction site should be clear for operation by Fire Department in case of emergency; In case if there are any Telecom Electric or Trees planted such obstacles should be cleared.
- All Drain covers and flooring within premises should be of heavy duty with minimum load bearing capacity of 25 Tons if building is below 45 meters height and 50 Tons if building is above 45 Meters.
- Four way collecting head should be out of premises but on front side of tower, and Two Way collecting head for each tower separately.
- Proper Ventilation should be taken care of; Smoke management system should be connected with generator.
- Emergency Lift, Staircases, Ramp, Water tank OH/UG (Inlet should be connected to VMC water supply line), Passage & Corridors should be kept as per guideline of NBC 2016. (Applicable to 18 Meters & above: Every Tower should have Individual Underground water tank with Capacity of 1 Lakh Liters and Overhead tank with Capacity of 20000 Liters connected to Fire Pump supported by Generator/Diesel Pump. Testing of water pressure will be done once pump is connected with GEB & Generator connection)
- In case of any specific suggestion or changes guided by Chief Fire Officer should also be done on priority basis.
- Fix Firefighting systems & instruments should be of ISI Standards.
- GEB Transformers should not be in morotable road.
- The Highest point of the tower should have approved Lightning arrester.
- FSC will be issued for the purpose that is mentioned at time of application if the structure is used for other then mentioned one, the Given FSC will stand terminated
- NOC Status of Buildings, Structures, or Premises that are directly or indirectly involved in legal proceedings/matter that is on-going in a court with respect to its ownership, construction type, durability or any such court matter will be terminated with immediate effect
- Entrance gate of the society should be minimum 6 Meters in width and 5Meters in height.
- In case if you are appointing Fire Safety Vendors they should Registered Fire Vendors.
- If Floor area is big, than for every Staircase there should be separate Riser Line.
- Isolation Valve with Two way collecting head to be placed on all Raiser Line.
- 3KG Flow pressure on terrace should be maintained.
- Smoke management system should be installed in basement with sprinklers system in case if area if more than 200 Sq. meters.
- Basement, Semi Basement and Second Basement all should have positive air pressure.
- External Staircase should be made available in case if needed or instructed.
- ACP/Glass facade elevation should be properly Ventilated and Openable on every floor. Glass quality for elevation should be as per standards of NBC for which certificate need to be provided.
- In case of Roof top shades be it any material are used it should be done such a way that they should not be obstacle in case of Fire Emergency.
- Electric wiring/cable installed in the premises should be as per Electricity Acts & Rules and should be tested from Government approved Electrical Inspector.
- Roads construction should be as it is mentioned/presented in plan. Quality of road should be of either Bituminous or Concrete.
- All Fire Signage should be installed with Emergency Evacuation plan (Auto Glow).
- Sky light wired Glass should be minimum of 30 minutes fire resistance as per NBC and certificate for the same to be produced.
- HFL Levels should be maintained at time of Construction (D-Watering pumping System should be installed).
- If construction work is not completed within 3 years from the date of Opinion certificate issued, in such case NOC will be considered as terminated.
- If any wrong information if provided for the road in the given Map NOC will not be considered valid.
- Other than Special Building construction like Residential Building, Commercial Building, Residence + Commercial, School/College, Hospitals, Hotel/Restaurants/Party Plot/Petrol Pump/ Classes and any others places where public gatherings are done will have to follow all above given instruction at all time in case of violation the issued NOC will be "Canceled".

I GOPINATH ENTERPRISE AND OTHERS the undersigned have read and understood all the above instructions.

Designation of Receiver:

Contact details:

Receivers

VFES/FSAP/OUTWARD: 1598/23-24

Date: 26-07-2023



Pramod Prafulbhai Patel Partner of Pride Associates

Date: 15-07-2021

Near Sardar chowk, Bhayli
Village, Bhayli, Vadodara -
391410.

System Generated Auto Assessment for Height Clearance

1. Airports Authority of India (AAI) in pursuance of responsibility conferred by and as per the provisions of Govt. of India (Ministry of Civil Aviation) order GSR 751 (E) dated 30th Sep. 2015 for Safe and Regular Aircraft Operations has assessed the site data filled by the applicant.

2. Assessment details for Height Clearance:

NOC ID :	VADO/WEST/B/071421/560972
Applicant Name*	Vinu B. Patel
Site Address*	F.P.No.66, BLOCK No.447, T.P.S.No.4 of Village Bhayli, Taluka and dist. Vadodara.
Site Coordinates*	22 16 43.47N 73 07 42.44E, 22 16 40.96N 73 07 43.05E, 22 16 43.78N 73 07 44.45E, 22 16 41.38N 73 07 45.07E, 22 16 41.55N 73 07 45.19E, 22 16 41.43N 73 07 45.20E
Site Elevation in mtrs AMSL as submitted by Applicant*	29.6 M
Type Of Structure*	Building

*As provided by applicant

Your site is located at a distance 10935 mts from ARP and lies in the grid O7 of the published CCZM of Vadodara airport. The Permitted top elevation for this grid is 100 mts.

Since the requested top elevation 79.9 mts in AMSL is below CCZM permitted top elevation, the NOC for height clearance is not required from Airports Authority of India.

3. This assessment is subject to the terms and conditions as given below:

- The site-elevation and site coordinates provided by the applicant are taken for calculation of the permissible top elevation for the proposed structure. If however, at any stage it is established that the actual data is different from the one provided by the applicant, this assessment will become invalid.
- The Site coordinates as provided by the applicant in the NOC application has been plotted on the street view map and satellite map as shown in ANNEXURE. Applicant/Owner to ensure that the plotted coordinates corresponds to his/her site. In case of any discrepancy, this assessment shall be treated as null and void.
- Airport operator or his designated representative may visit the site (with prior coordination with applicant or owner) to ensure that assessment terms & conditions are complied with.
- The assessment is further subject to the provisions of Section 9-A of the Indian Aircraft Act, 1934 and any notifications issued there under from time to time including the Aircraft (Demolition of Obstruction caused by Buildings and Trees etc.) Rules, 1994.



भारतीय विमानपत्तन प्राधिकरण
AIRPORTS AUTHORITY OF INDIA

e. The applicant is responsible to obtain all other statutory clearances from the concerned authorities including the approval of building plans. This assessment for height is to ensure the safe and regular aircraft operations and shall not be used as document for any other purpose/claim whatsoever, including ownership of land etc.

f. Use of oil, electric or any other fuel which does not create smoke hazard for flight operations is obligatory, within 8 KM of the Aerodrome Reference Point.

g. This assessment has been issued w.r.t. the Civil Airports as notified in GSR 751(E). Applicant needs to seek separate NOC for Defence, if the site lies within jurisdiction of Defence Airport. Applicants also need to seek clearance from state Govt. as applicable, for sites which lies in the jurisdiction of unlicensed civil aerodrome as outlined in Rule 13 of GSR751 (E).

This assessment is system auto generated and thus does not require any signature

Designated Officer


Region Name: WEST

Address: General Manager Airports
Authority of India, Regional
Headquarter, Western Region,
Opp. Parsiwada, Sahar Road,
Vale Parle (E)

Email ID: nocwr@aai.aero

Contact No: 022-28300656

Street View

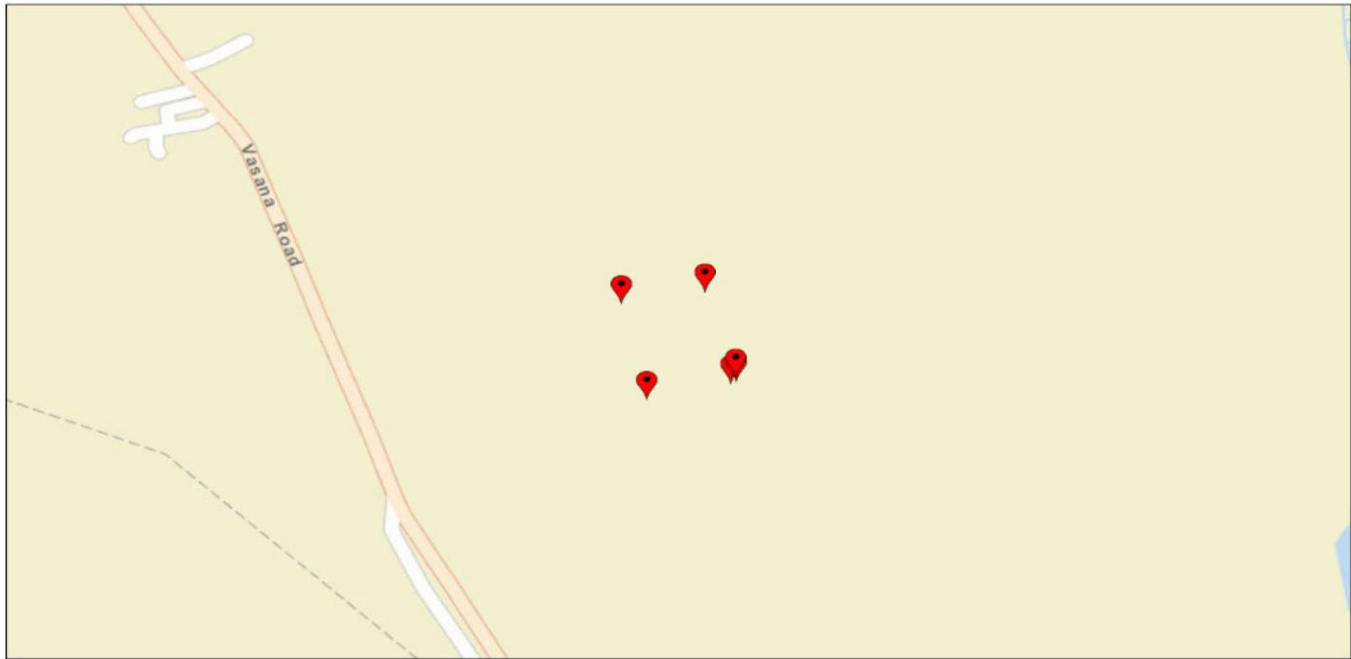

July 14, 2021

1:3,600
0 0.03 0.06 0.11 mi
0 0.04 0.09 0.18 km

Sources: Esri, HERE, Garmin, USGS, Intermap, INCREMENT P, NRCan, Esri Japan, METI, Esri China (Hong Kong), Esri Korea, Esri (Thailand), NGCC, (c) OpenStreetMap contributors, and the GIS User Community

AAI

Satellite View



July 14, 2021

1:3,600
0 0.03 0.06 0.11 mi
0 0.04 0.09 0.18 km

Sources: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

AAI

કલેક્ટર અને જિલ્લા મેજિસ્ટ્રેટની કચેરી, વડોદરા

કલેક્ટર કચેરી, કોઠી બિલ્ડિંગ, રાવપુરા, વડોદરા - ૩૯૦૦૦૧

ફોન નંબર : ૦૨૬૫-૨૪૩૩૦૦૦

ઇ-મેઇલ : collector-vad@gujarat.gov.in



ગુજરાત જમીન મહેસૂલ અધિનિયમ-૧૯૭૯ ની કલમ-૬૫(અ) હેઠળ [બિનખેતી હેતુકેર - બહુહેતુક ઉપયોગ]

હુકમ નં. 97/19/18/036/2022

તા. 12/01/2022

(૧) અરજદારશ્રી PRAMAD PRAFULBHAI PATEL

રહે. B 95, RAJLAXMIN SOCIETY, RACE COURSE, NR SHIVMAHAL PALACE, O P ROAD, VADODARA-390007 ની તા. 19/11/2021 ની ઓનલાઇન અરજી તથા સોગંદનામું

(૨) ગુજરાત જમીન મહેસૂલ અધિનિયમ-૧૯૭૯ ની કલમ-૬૫(અ), ૪૮ અને આનુષંગિક નિયમ ઠરાવ અને પરિપત્રોની જોગવાઈઓ.

(૩) મામલતદાર અને કૃષિપંચ શ્રી (ALT) નો તા.01/12/2021 નો અભિપ્રાય

હુકમ :-

વંચાણે લીધેલ કમ (૧) ની અરજી તથા સોગંદનામા થી અરજદારશ્રી PRAMAD PRAFULBHAI PATEL એ મોજે ભાચલી તા. વડોદરા શહેર (પશ્ચિમ) જિ. વડોદરા ના સરવે/બ્લોક નં. 447 ના ક્ષેત્રફળ 6,880.00 ચો.મી. પૈકી ક્ષેત્રફળ 675.00 ચો.મી ની જમીન અંગે ગુજરાત જમીન મહેસૂલ અધિનિયમ-૧૯૭૯ ની કલમ-૬૫(અ) હેઠળ બિનખેતી હેતુકેરની પરવાનગી મેળવવાની માગણી કરેલ છે. સવાલવાળી જમીનના ગામ નમૂના નં. ૭/૧૨ માં કબજેદારોની વિગત નીચે મુજબ છે.

સરવે/બ્લોક નંબર ટી.પી. નંબર એફ.પી. નંબર	માંગણીનું ક્ષેત્રફળ (ચો.મી.)	કબજેદારોના નામ (ખાતા નં. 1890)
સરવે/બ્લોક નં. : 447 જુનો સરવે/બ્લોક નં. : --- ટી.પી. નં. : 4 એફ.પી. નં. : 66	675.00	પટેલ અભીષેક દ્રારકાદાસ (એચ.યુ.એફ) વતી અને કતો પટેલ અભિષેક દ્રારકાદાસ પ્રાઇડ એસોસિયેટસ એ નામની ભાગીદારી પેઢી વતી ભાગીદારો તથા કુ.મુ. વ.કર્તા ૧.પ્રમદ પ્રફુલભાઈ પટેલ (૨૦ ટકા) (ક્ષે.૨૪૦૯ ચોમી ઉત્તર દિશા તરફની જમીન) ૨.ભૈરવી પ્રમદ પટેલ (૧૯ ટકા) ૩.વિદ્યાસાગર સ્વામી નાદર (૨૧ ટકા) ૪.સુખા વિદ્યાસાગર સ્વામી (૨૦ ટકા) ૫.ભરતકુમાર જયંતિલાલ પટેલ (૧૦ ટકા) ૬.મીતાબેન ભરતકુમાર પટેલ (૧૦ ટકા)

સવાલવાળી જમીન અંગેના રજૂ થયેલ રેકર્ડની ચકાસણી કરતાં સદર જમીન હાલમાં બિનખેતી સત્તાપ્રકારે ચાલતી આવે છે. તેમજ અરજદારે સોગંદનામામાં જાહેર કરેલ હકીકત તથા અન્ય આધાર પુરાવાઓ ધ્યાને લેતા મહેસૂલી ટાઇટલ કિલચર હોવાનું જણાય છે. જેથી બિનખેતી હેતુકેરની પરવાનગી આપવાપાત્ર જણાય છે. હુકમના ઉપરોક્ત વંચાણે લીધેલ પત્રમાં જણાવેલ વિગતે અરજદારને રૂપાંતર કર, વિશેષ ધારો તથા અન્ય વેરાની રકમ સરકારશ્રીમાં ભરપાઇ કરવા ઓનલાઇન સિસ્ટમ દ્વારા તેઓને જાણ કરતાં, નીચે જણાવેલ વિગતે ઓનલાઇન સિસ્ટમ દ્વારા અરજદારે નાણા સરકારશ્રીમાં જમા કરાવેલ છે. જે નીચેની વિગતે છે.

કરની વિગત	સદર	માંગણીનું ક્ષેત્રફળ (ચો.મી.)	દર/ તફાવત દર રૂ. પ્રતિ ચો.મી.	કુલ રકમ રૂ.
રૂપાંતર કર	569-0035-00-800-01	675.00	40.00	27,000.00
વિશેષ ધારો	570-0035-00-101-01	675.00	0.65	439.00
લોકલ ફંડ	574-0029-00-103-01	675.00	1.80	1,215.00
શિક્ષણ ઉપકર	575-0045-00-108-01	675.00	0.45	304.00
દંડનીય રકમ	570-0035-00-101-01	---	---	1,63,600.00

માપણી ફી	577-0029-00-106-01	675.00	---	1,800.00
કુલ રૂ.				1,94,358.00

સબબ, ઉપરોક્ત હકીકત ધ્યાનમાં લેતાં નીચે દર્શાવ્યા મુજબની જમીન અંગે, જમીન મહેસૂલ કાયદાની કલમ-૬૭(ક) હેઠળ નિયમાનુસાર દંડ વસૂલ લઈ હુકમમાં જણાવેલ શરતોને આધીન જમીન મહેસૂલ કાયદાની કલમ-૬૫(અ) હેઠળ કાર્યવાહી થયા બાદ સક્ષમ સત્તાધિકારી દ્વારા મળવાપાત્ર બાંધકામના પ્રમાણિત નકશા મુજબ બિનખેતી હેતુકેર [બહુહેતુક ઉપયોગ] કરવા પરવાનગી આપવા આથી હુકમ કરવામાં આવે છે.

-: મોજે: ભાયલી તાલુકા: વડોદરા શહેર (પશ્ચિમ) ની જમીન બિનખેતી હેતુકેર કરવાની વિગત :-

સરવે/બ્લોક નંબર ટી.પી. નંબર એફ.પી. નંબર	જમીનનું ઝ/૧૨ મુજબ ક્ષેત્રફળ (ચો.મી.)	અગાઉના હુકમ મુજબ બાંધકામ સહિત બિનખેતી કરવામાં આવેલ જમીનનું ક્ષેત્રફળ (ચો.મી.)	આ હુકમથી બિનખેતી કરવામાં આવેલ જમીનનું ક્ષેત્રફળ (ચો.મી.)
સરવે/બ્લોક નં. : 447 જુનો સરવે/બ્લોક નં. : --- ટી.પી. નં. : 4 એફ.પી. નં. : 66	6,880.00	4,818.00	675.00

શરતો :-

- (૧) આ હુકમ મળ્યેથી બે માસમાં "એમ" નમૂનામાં સનદ પ્રાપ્ત થશે.
- (૨) જિલ્લા ઇન્સ્પેક્ટરશ્રી, જમીન રેકર્ડની કચેરીમાં માપણી ફી જમા કરાવેલ છે. જયી માપણી કરી / કરાવી આ હુકમ આધારે તેમજ મંજૂર થયેલ પ્લાન મુજબ દુરસ્તી પત્રક તૈયાર કરવાનું / કરાવવાનું રહેશે અને દુરસ્તી પત્રકનો મહેસૂલી દફતરે અમલ થયા બાદ જ પ્રશ્નવાળી બિનખેતીની જમીન / પ્લોટનું રજી. દસ્તાવેજથી થયેલ વેચાણ વ્યવહારના અમલ માટે નોંધ પાડવાની રહેશે.
- (૩) અરજદારે પ્રતિ વર્ષે ખેતી સિવાયનો ધારો (વિશેષધારો) દર પ્રતિ ચો.મી. ના રૂ. 0.65 પ્રમાણે રૂ. 439.00 તેમજ નિયમ પ્રમાણે લોકલ ફંડ તથા શિક્ષણ સેસ ભરવો પડશે જે અંગેનો દર વખતોવખત ફેરફારને પાત્ર રહેશે.
- (૪) વડોદરા મહાનગરપાલિકા એ મંજૂર કરેલા પ્લાન મુજબ બાંધકામ કરવાનું રહેશે.
- (૫) સરકારશ્રીના મહેસૂલ વિભાગના ઠરાવ નં. બખપ/૧૦૯૩/૧૦૫૨/૬ તા. ૧૩/૦૯/૧૯૯૩ માં ઠરાવ્યા મુજબ સહીયારા / કોમન પ્લોટ અને રસ્તાની જમીન સોસાયટીની માલિકીની અથવા સર્વે પ્લોટ હોલ્ડરની સહીયારી માલિકીની ગણાશે તે ઉપર મુજબ માલિકનો કોઈ હકક રહેશે નહિ.
સરકારશ્રીના મહેસૂલ વિભાગના તા. ૦૭/૦૮/૧૯૯૧ ના પરિપત્ર નં. બખપ-૧૦૯૧/૧૭૫૬/૬ ની જોગવાઈ મુજબ બિન અધિકૃત બાંધકામ બાબતે બાંધકામ નિયંત્રણ કરતી સંબંધિત મહાનગરપાલિકા / શહેરી વિસ્તાર સત્તા મંડળએ ધોરણસરનાં પગલાં લેવાનાં રહેશે.
- (૬) સદર જમીનમાંથી પેટ્રોલીયમ / પાણીની કે અન્ય કોઈપણ પ્રકારની પાઇપલાઇન પસાર થતી હશે તો તે સંદર્ભે વિકાસ પરવાનગી આપનાર ઓથોરિટીએ સંબંધિતોનું ના-વાંધા પ્રમાણપત્ર મેળવી વિકાસ પરવાનગી આપવાની રહેશે.
- (૮) સરકારશ્રીનાં મહેસૂલ વિભાગનાં તા. ૦૧/૦૭/૨૦૦૮ ના ઠરાવ નં. બખપ/૧૦૦૬/૪૨૫/૬ માં જણાવેલ નીચે મુજબની શરતોનું પાલન કરવાનું રહેશે.
 ૧. જિલ્લા ઇન્સ્પેક્ટરશ્રી, જમીન રેકર્ડ દ્વારા ઇસ્યુ કરાયેલ માપણી શીટ કે જેના ઉપર મૂળ ટિપ્પણની હદ પણ દર્શાવેલ હોવી જોઈએ. રજૂ કરાયેલ પ્લાન તથા લે-આઉટ પ્લાન સક્ષમ કક્ષાએ મંજૂર કરાયેલ હોવી જોઈએ.
 ૨. બાંધકામ શરૂ કરતા પહેલા બાંધકામનાં નકશા સક્ષમ અધિકારી પાસે મંજૂર કરાવવાના રહેશે. પરંતુ અરજદાર બિનખેતી પરવાનગી મેળવ્યા વગર આવા બાંધકામની રજા ચિઠ્ઠી મેળવી શકશે નહિ.
 ૩. શહેરી વિસ્તાર જ્યાં ટાઉન પ્લાનિંગ સ્કીમ મંજૂર થઇ ગઇ છે ત્યાં જી.ડી.સી.આર. અને ઝોનિંગના નિયમો અનુસાર બાંધકામ કરવાનું રહેશે.
 ૪. મંજૂર થયેલ નકશા મુજબ આરોગ્ય અને સ્વાસ્થ્યની દ્રષ્ટિએ ગંદા પાણીનાં નિકાલની જોગવાઈ કરવાની રહેશે.
 ૫. અરજદારે રિબન ડેવલપમેન્ટ રુલ્સ નીચે જે તે રસ્તાનો પ્રકાર ધ્યાને લઈ રસ્તાના મધ્યબિંદુથી બાંધકામ વચ્ચે અંતર જાળવવાનું રહેશે અન્યથા અરજદારની જવાબદારી થશે.
 ૬. ફ્લોર, મિલ, સિનેમા/ ટુરિંગ સિનેમા/ થિયેટર માટે બિનખેતી પરવાનગીના કામે જિલ્લા મેજિસ્ટ્રેટની જરૂરી મંજૂરી મેળવી આગળની કાર્યવાહી કરવાની રહેશે.
 ૭. પેટ્રોલ, ડીઝલ, કેરોસીન, સી.એન.જી., એલ.પી.જી. પંપ નાંખવા માટે બિનખેતી પરવાનગીના કામે બાંધકામ શરૂ કરતાં પહેલા જિલ્લા મેજિસ્ટ્રેટની જરૂરી મંજૂરી મેળવી આગળની કાર્યવાહી કરવાની રહેશે.



૮. ઇન્ડિયન એક્સપ્લોઝિવ એક્ટ અન્વયે મેગેનિઝ, ફાયર વર્ક્સ, દારૂખાના માટે બિનખેતીની કાર્યવાહી કરતા પહેલા જિલ્લા મેજિસ્ટ્રેટની જરૂરી મંજૂરી મેળવી આગળની કાર્યવાહી કરવાની રહેશે.
૯. સવાલવાળી જમીન જો રેલવે હદની નજીક હોય તો રેલવેની હદથી નિયમ મુજબ જગ્યા છોડી બાંધકામ કરવાનું રહેશે.
૧૦. સવાલવાળી જમીન ઉપરથી અથવા બાજુમાંથી વીજળી ગ્રિડના તાર/ હાઇટેન્શન પાવર અગર થાંભલા આવેલ હોય ત્યારે તે અન્વયે લાગુ પડતા નિયમોનું પાલન કરવા અને તે મુજબ બાંધકામ કરવાનું રહેશે.
૧૧. બિનખેતી માંગવામાં આવી હોય તેવી જમીન જો એરોડ્રામ આસપાસ નિયમ મુજબની ત્રિજ્યામાં આવતી હોય ત્યારે બાંધકામની ઉંચાઈ તથા એરોડ્રામની દ્રષ્ટિએ જરૂરી એવું ના-વાંધા પ્રમાણપત્ર સિવિલ એવિએશન ખાતા પાસેથી મેળવવાનું રહેશે અને સિવિલ એવિએશન ખાતાના નિયમોનું પાલન કરવાનું રહેશે.
૧૨. ઓ.એન.જી.સી. ના કુવાની નજીકમાં આવેલ જમીનના કિસ્સામાં અરજદારે સંબંધિત નિયમોનું પાલન કરવાનું રહેશે.
૧૩. નર્મદા કેનાલ/ અન્ય સિંચાઈ કેનાલની નજીકમાં આવેલ જમીનની બાબતમાં અરજદારે સૂચિત બાંધકામ માટે જાળવવાના થતાં અંતર અંગેના નિયમોનું પાલન કરવાનું રહેશે.
૧૪. અરજદારે/ જ્યાં જરૂરી હોય ત્યાં કેન્દ્ર સરકાર કે રાજ્ય સરકારના કાયદા નીચે રક્ષિત સ્મારક (Protected Monuments) તરીકે જાહેર કરેલ પ્રાચીન સ્મારકથી નિયમ મુજબનું અંતર જાળવવાની પ્રવર્તમાન જોગવાઈઓનું પાલન કરવાનું રહેશે.
- (૯) જો આ જમીન પર કોઈ બેંક/ મંડળીનો બોજો બાકી હોય તો, તે ભરપાઈ કર્યા સિવાય આ મિલકત કોઈપણ પ્રકારે વેચાણ, ભેટ, વસિયત, બાનાખત, ગિરો કરી શકાશે નહિ અને કોઈપણ અન્યને પ્રત્યક્ષ કે પરોક્ષ રીતે માલિકી કે કબજો ભોગવટો તબદીલ કરી શકાશે નહિ.
- (૧૦) પ્રશ્નવાળી જમીનમાં નગરપાલિકા/ મહાનગરપાલિકા/ શહેરી વિકાસ સત્તા મંડળ દ્વારા જે શરતોએ પરવાનગી આપવામાં આવશે તે શરતોનું પાલન તથા બાંધકામ કરવાનું રહેશે.
- (૧૧) આ જમીનમાં વરસાદી પાણીના ભુગર્ભ વહન/ સંચય માટે દર મકાન/ બહુમાળી મકાન દીઠ એકના દરે આ જમીનમાં ઉપર પરકોલેટીંગ બોરવેલની વ્યવસ્થા અચૂક કરવાની રહેશે તથા વરસાદી પાણીના નિકાલની વ્યવસ્થા કરીને બાંધકામ કરવાનું રહેશે.
- (૧૨) ઉપરની કોઈપણ શરતનો ભંગ થયેથી જમીન મહેસૂલ કાયદાની કલમ-૬૭ મુજબ શિક્ષાત્મક પગલા લેવામાં આવશે તેમજ બીજી કોઈપણ શિક્ષાને પાત્ર હશે તો તેને બાધ આપ્યા સિવાય કે જે ફરમાવવાનું યોગ્ય લાગે તે પ્રમાણે દંડ અથવા આકાર લઈ સદરહુ જમીનનો કબજો કબજેદાર પાસે ચાલુ રહેવા દઈ શકાશે.
- (૧૩) ઉપરોક્ત શરતોમાં ગમે તે મજફૂર હોય તેમ છતાં, કલેક્ટરશ્રી સદરહુ હુકમ વિરુદ્ધ બાંધેલા અથવા વધારાના કોઈપણ મકાન અથવા ઇમલારને કલેક્ટરશ્રીએ, આ અર્થે જે મુદત ઠરાવી હોય તે મુદત દરમિયાન તેવી રીતે ખસેડવામાં ન આવે કે સૂચવ્યા મુજબ ફરજર ન કરવામાં આવે તો તેમ કરવામાં જે ખર્ચ થાય તે કબજેદાર પાસેથી જમીન મહેસૂલની બાકી તરીકે વસુલ કરવાને મુખત્યાર છે.
- (૧૪) મંજૂરી હેઠળની જમીન પરત્વે અલગ અલગ હિસ્સા (સબ પ્લોટ) ના કિસ્સામાં સંબંધિત ડી.ઇ.લે.રે. કચેરીમાં માપણી ફી અલગ અલગ ભરપાઈ કરવાની રહેશે.



(૧૫) સવાલવાળી જમીન સંબંધે ભવિષ્યમાં તૈયાર થનાર વિકાસ યોજના અને નગર રચના યોજના સંબંધે સરકારશ્રી/સત્તામંડળ/નગર રચના અધિકારીશ્રી દ્વારા જે કોઈ દરખાસ્ત આપરી કરવામાં આવે તો તે અરજદારશ્રી/જમીન માલિક/મિલકતધારકોને બંધનું કરવું રહેશે. સવાલવાળી જમીનમાં સ્થળ પર કોઈપણ પ્રકારનું વિકાસ કામ કરતા અગાઉ વડોદરા શહેરી વિકાસ સત્તા મંડળની વિકાસ પરવાનગી મેળવવાની રહેશે.

૧૬ મહેસુલ વિભાગના પરીપત્ર ક્રમાંક બખપ/૧૦૨૦૧૮/૩૨૭/ક તા.૦૮/૦૫/૨૦૧૮ ની સુચના મુજબ શહેરી વિકાસ વિભાગના લાગુ પડતા સક્ષમ સત્તાધિકારીશ્રીઓ જમીનના ઉપયોગ પ્રમાણે પ્લાન રજુ થતા જે તે વિસ્તારના અમલી નિયમો પ્રમાણે નિર્ણય કરશે અને ભવિષ્યમાં જ્યારે મંજૂર થયેલ પ્લાન વિરુદ્ધ કોઈપણ બાંધકામ થાય અથવા તો કોઈપણ રીતે મંજૂરીનું ઉલ્લંઘન થાય તો નિયમોનુસારની કાર્યવાહી સક્ષમ સત્તાધિકારી કરશે.

૧૭ ભારતીય વાયુસેનાના હવાઈમથક તથા ઇન્સ્ટોલેશનથી બાંધકામ કરવાની મર્યાદા ભારત સરકારના સંરક્ષણ મંત્રાલય દ્વારા જાહેરનામાથી વખતો વખત બહાર પાડવામાં આવે તેટલી ત્રિજ્યા બહાર બાંધકામ કરવાનું રહેશે.

૧૮ સવાલવાળી જમીન જો જેલથી નજીક હોય તો ૧૮૪ મીટર છોડીને બાંધકામ કરવાનું રહેશે.

૧૯ જી.ડી.સી.આર મુજબ જે તે હેતુ / ઉપયોગ માટે પરવાનગી મળવાપાત્ર નહીં હોય તો તે ઉપયોગ કરી શકાશે નહીં.

૨૦ ખેતી ઝોનમાં જીડીસીઆર મુજબ જેટલું બાંધકામ મળવાપાત્ર હશે તેટલા જ ક્ષેત્રફળ માટે વિકાસ પરવાનગી આપવાની રહેશે
૨૧ બિનખેતી પરવાનગી મળ્યા બાદ જો ખાસ મંજૂરી વિના ધાર્મિક ઉપયોગ માટે બાંધકામ કરેલ હશે તો તે શરતભંગ ગણાશે અને તે બાંધકામ દુર કરવાપાત્ર થશે.

૨૨ સવાલવાળી જમીન અંગે મંજૂર થયેલ દ્વિતિય પુનરાવર્તિત વિકાસ યોજનાની કપાત ધ્યાને લઈ વિકાસ પરવાનગી આપવાની રહેશે. તથા જો સવાલવાળી જમીનનો ટી.પી.સ્કીમમાં સમાવેશ થયેલ હોય તો પુન વહેંચણી અને મુલ્યાંકન પત્રકમાં દર્શાવેલ વિગતો મુજબનો અમલ કરવાનો રહેશે.

૨૩ સવાલવાળી જમીનમાં ટી.પી.કપાતની જમીનમાં અરજદારનો કોઈ માલીકી હકક રહેશે નહીં તથા તેમાં કોઈ તબદીલી કરી શકાશે નહીં.

૨૪ સવાલવાળી જમીન અન્વયે થયેલ કલેક્ટરશ્રી વડોદરાના હુકમ નં. એન.એ/એસ.આર/૬૪/૨૦૧૬-૨૦૧૭

નં.જમીન-ડી/કલમ-૬૫/વશી/૮૧૦૫થી૮૧૧૩/૨૦૧૬ તા.૨૪/૧૦/૨૦૧૬નાબિનખેતી હુકમની શરતોનું પાલન કરવાનું રહેશે.

વધુમાં ઉપર્યુક્ત શરતોને આધિન અરજદાર દ્વારા રજુ થયેલ સોગંદનામાની વિગતોમાં તેઓ દ્વારા જાહેર કરેલી હકીકતોને આધારે સવાલવાળી જમીનના બિનખેતી ઉપયોગ માટે પરવાનગી આપવામાં આવે છે. તદઅનુસાર સંબંધિત મામલતદારશ્રીએ આ હુકમની ગામના તથા તાલુકાના સંબંધિત રેકર્ડમાં નોંધ રાખી પ્રતિ વર્ષ વિશેષધારો તથા અન્ય ઉપકર વસુલ કરવાના રહેશે.



(આર. બી. બારડ)
કલેક્ટર, વડોદરા

આર.પી.એ.ડી.

પ્રતિ,

PRAMAD PRAFULBHAI PATEL

B 95 , RAJLAXMIN SOCIETY , RACE COURSE

NR SHIVMAHAL PALACE

O P ROAD

VADODARA-390007

નકલ રવાના:-

૧. નાયબ કલેક્ટરશ્રી, વડોદરા (શહેર) પ્રાંત, જિ. વડોદરા તરફ.
૨. મામલતદારશ્રી તા. વડોદરા શહેર (પશ્ચિમ) જિ. વડોદરા તરફ.
૩. જિલ્લા ઇન્સ્પેક્ટરશ્રી જમીન રેકર્ડ વડોદરા તરફ.
૪. તલાટીશ્રી ભાયલી તા. વડોદરા શહેર (પશ્ચિમ) જિ. વડોદરા તરફ.

* આ હકમની ઇ-ધરા કેન્દ્ર, વડોદરા શહેર (પશ્ચિમ) માં નોંધ નંબર 17897 થી મોજે- ભાયલી તા.- વડોદરા શહેર (પશ્ચિમ) જિ.- વડોદરા માં નોંધ થયેલ છે.

